

**REGIONAL WATER TESTING LAB, AMRITSAR**  
New Golden Avenue, Opposite Dhobi Ghat, Near Jaura Phatak, Amritsar.  
rwtlasr1@gmail.com

To,

Principal Bhavan SL Public School  
Opp.Shivala Bhaiyan,Amritsar

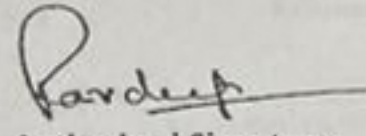
No.: RWTLASR/2526/00023 Dated : 24/04/2025

Subject : Testing Reports of Water Samples.

Reference: Your Letter/SRF No. BVB-26507 Dated: 15/04/2025

As per above cited subject and reference, Please find enclosed here with the report of 1 Water sample/s received on dated 15/04/2025. It is request to fill the attached feedback form and send it back to Regional Water Testing Lab, Amritsar

D/A : Test Report

  
Authorized Signatory  
For, Regional Water Testing Lab  
Amritsar

**REGIONAL WATER TESTING LAB, AMRITSAR**  
New Golden Avenue, Opposite Dhobi Ghat, Near Jaura Phatak, Amritsar.  
rwtlasr1@gmail.com



**TEST REPORT**

TC-13602


Name & Address of Customer : Principal Bhavan SL Public School Opp.Shivala Bhaiyan,Amritsar		Customer Reference No.	No : BVB-26507 Dated : 15/04/2025	
		Sample Submitted by	Mr.Rohit	
		Date of Sample Receipt	15/04/2025	
		Analysis Starting Date	15/04/2025	
		Analysis completion Date	16/04/2025	
Discipline : Chemical Testing		Group: Water		
ULR No.:	TC136022500000256F	Sample Type :	Water	
Test Report No.:	RWTLASR/2526/00023	Date of Issue :	24/04/2025	
Registration no.:	RWTLASR/REG2526/00203	Condition of Sample :	Unsealed	
Collection Point:	Private Submersible	Quantity/Type of Bottle:	1000 ml / Plastic Bottles	
Scheme/Source:	Not Mentioned(Not Mentioned)	Location/Depth :	Shivala Bhaiyan(S/pump 160 ft) / NA	
Village :	Not Mentioned	Habitation :	Not Mentioned	
Block:	Not Mentioned	District :	Amritsar	
Latitude :	Not Mentioned	Longitude:	Not Mentioned	

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.24@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	551	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	0.63@25°C	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	Alkalinity(CaCO3)	412	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	Hardness(CaCO3)	448	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	104.20	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	45.68	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	199.9	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

This Report is issued under the following terms & Condition :

- The results apply to the sample as received only.
- The sample will be destroyed after retention time unless otherwise specified specially.
- This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
- Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected)
- \* Value not available or test not performed for this parameter.
- Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By

  
Mr. Pardeep kumar  
Quality Manager  
Authorized Signatory  
For,Regional Water Testing Lab  
Amritsar

End of the Test Report